

# ATTACHMENT 1D

Revised: August 7, 2019



**Date:** September 24<sup>th</sup> , 2019

**Attention:** Eugen Fera

**RE:** Request for Comments

**File No.:** 19T-16V007

**Applicant:** Frank Greco

**Location** Part Lot 30, Concession 9



## COMMENTS:

☐

We have reviewed the Proposal and have no comments or objections to its approval.

☒

We have reviewed the proposal and have no objections to its approval, subject to the following comments (attached below).

☐

We are unable to respond within the allotted time for the following reasons (attached) you can expect our comments by \_\_\_\_\_.

☐

We have reviewed the proposal and have the following concerns (attached below)

☐

We have reviewed the proposal and our previous comments to the Town/City, dated \_\_\_\_\_, are still valid.

Alectra Utilities has received and reviewed the submitted plan proposal. This review, however, does not imply any approval of the project or plan.

The owner(s), or his/her/their agent, for this plan is/are required to contact Alectra Utilities to obtain a subdivision application form (SAF) and to discuss all aspects of the above project. The information on the SAF must be accurate to reduce unnecessary customer costs, and to provide a realistic in-service date. The information from the SAF is also used to allocate/order materials, to assign a technician to the project, and to place the project in the appropriate queue. A subdivision application form is enclosed with this request for comments.

Alectra Utilities will prepare the electrical distribution system (EDS) design for the subdivision. The subdivision project will be assigned to an Alectra Utilities design staff upon receipt of a completed SAF. The design of the subdivision can only commence upon receiving a design prepayment and the required information outlined on the SAF.

Alectra Utilities will obtain the developer(s) approval of the EDS design, and obtain the required approvals from local government agencies for EDS installed outside of the subdivision limit. Alectra Utilities will provide the developer(s) with an Offer to Connect (OTC) agreement which will specify the responsibilities of each party and an Economic Evaluation Model outlining the cost sharing arrangement of the EDS installation between both parties. The OTC agreement must be executed by both parties and all payments, letter of credits and easements received in full before Alectra Utilities can issue the design for construction.

All proposed buildings, billboards, signs, and other structures associated with the development must maintain minimum clearances to the existing overhead or underground electrical distribution system as specified by the Ontario Electrical Safety Code and the Occupational Health and Safety Act.

All communication, street light or other pedestal(s) or equipment(s) must not be installed near Alectra Utilities transformers and/or switchgears. Enclosed with this request for comments are Alectra Utilities clearance standards.

Existing Alectra Utilities plant in conflict due to driveway locations or clearances to the existing overhead or underground distribution system will have to be relocated by Alectra at the Developer's cost.

## ATTACHMENT 1D

Revised: August 7, 2019

We trust this information is adequate for your files.

Regards,

Mr. Tony D'Onofrio

Supervisor, Subdivisions

**Phone:** 905-532-4419

**E-mail:** [tony.donofrio@alectrautilities.com](mailto:tony.donofrio@alectrautilities.com)


Subdivision Application Information Form is available by emailing [tony.donofrio@alectrautilities.com](mailto:tony.donofrio@alectrautilities.com)

Revised: August 7, 2019



## Construction Standard

17-140

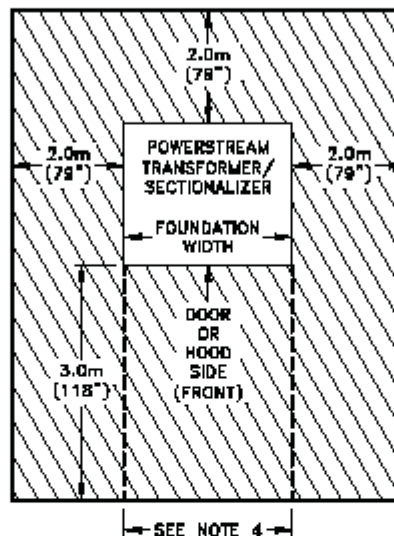

### NOTES:

1. FINAL GRADE WITHIN THE RESTRICTED OPERATIONAL CLEARANCE ZONE (SHOWN AS "HATCHED ZONES" ABOVE) MUST NOT BE ALTERED.
2. HATCHED ZONES AROUND THE APPARATUS AND IN FRONT OF ACCESS DOORS/HOODS TO REMAIN CLEAR OF ALL SHRUBS AND TREES. WHEN THE APPARATUS IS POSITIONED WITHIN THE HATCHED ZONE, THE ZONE WITHIN OR ABOVE MUST REMAIN CLEAR OF, INCLUDING BUT NOT LIMITED TO, BUILDINGS, STRUCTURES, FENCES OR OBSTRUCTIONS INCLUDING ANY LANDSCAPING FEATURES.
3. PREFERRED SURFACE COATING WITHIN THE HATCHED ZONES IS LAWN (SEEDED OR SOD) AND WITH PRIOR WRITTEN CONSENT OF POWERSTREAM GRAVEL AND/OR PAVED WITH ASPHALT OR PAVERS OR A CONCRETE FINISH MAY BE PERMITTED.
4. ACCESS TO ALL EQUIPMENT DOORS/HOODS MUST REMAIN PERMANENTLY CLEAR OF ALL OBSTRUCTIONS.

### PADMOUNT TRANSFORMER/SECTIONALIZER CLEARANCES

ORIGINAL ISSUE DATE: 2007-JAN-25 REVISION NO: 02 REVISION DATE: 2011-JUN-23

### REFERENCES

UNDERGROUND	SECTION 17
-------------	------------

### Certificate of Approval

This construction Standard meets the safety requirements of Section 4 of Regulation 22/04


Joe Corbin, P.Eng.	2011-JUN-23
Name	Date
P.Eng. Approved By:	Joe Corbin

Revised: August 7, 2019



## Construction Standard

17-141

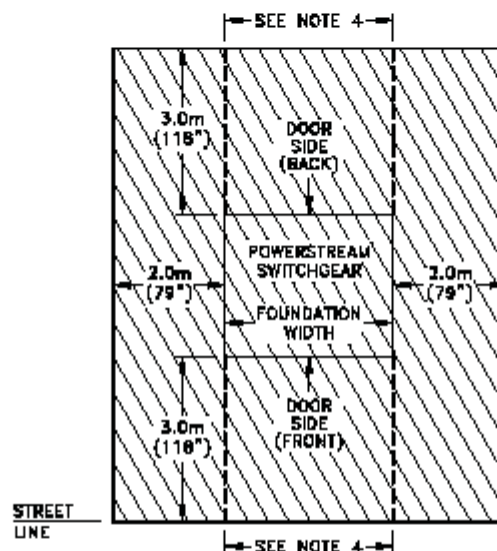

### NOTES:

1. FINAL GRADE WITHIN THE RESTRICTED OPERATIONAL CLEARANCE ZONE (SHOWN AS "HATCHED ZONES" ABOVE) MUST NOT BE ALTERED.
2. HATCHED ZONES AROUND THE APPARATUS AND IN FRONT OF ACCESS DOORS/HOODS TO REMAIN CLEAR OF ALL SHRUBS AND TREES. WHEN THE APPARATUS IS POSITIONED WITHIN THE HATCHED ZONE, THE ZONE WITHIN OR ABOVE MUST REMAIN CLEAR OF, INCLUDING BUT NOT LIMITED TO, BUILDINGS, STRUCTURES, FENCES OR OBSTRUCTIONS INCLUDING ANY LANDSCAPING FEATURES.
3. PREFERRED SURFACE COATING WITHIN THE HATCHED ZONES IS LAWN (SEEDED OR SOO) AND WITH PRIOR WRITTEN CONSENT OF POWERSTREAM GRAVEL AND/OR PAVED WITH ASPHALT OR PAVERS OR A CONCRETE FINISH MAY BE PERMITTED.
4. ACCESS TO ALL EQUIPMENT DOORS/HOODS MUST REMAIN PERMANENTLY CLEAR OF ALL OBSTRUCTIONS.

### REFERENCES

UNDERGROUND	SECTION 17
-------------	------------

**Certificate of Approval**  
This construction standard meets the safety requirements of Section 4 of Regulation 22/04

Joe Gruber, P.Eng. 2011-JUN-23  
Name Date  
P.Eng. Approved By: Joe Gruber

### PADMOUNT SWITCHGEAR CLEARANCES

ORIGINAL ISSUE DATE: 2008-JULY-07 REVISION NO: 02 REVISION DATE: 2011-JUN-23